

PLAN

1
6

Revision Date: _____


Scale : N/A Date : 06/01/05
 Design :
 Drawn : GAV
 Dwg. File : SMH_001.DWG
 Project No. : STANDARD-DETAILS


GARLAND
 ENGINEERING
 STANDARD DETAILS

**STORM SEWER MANHOLE
 WITH CAST-IN-PLACE RISER**

PAGE

1

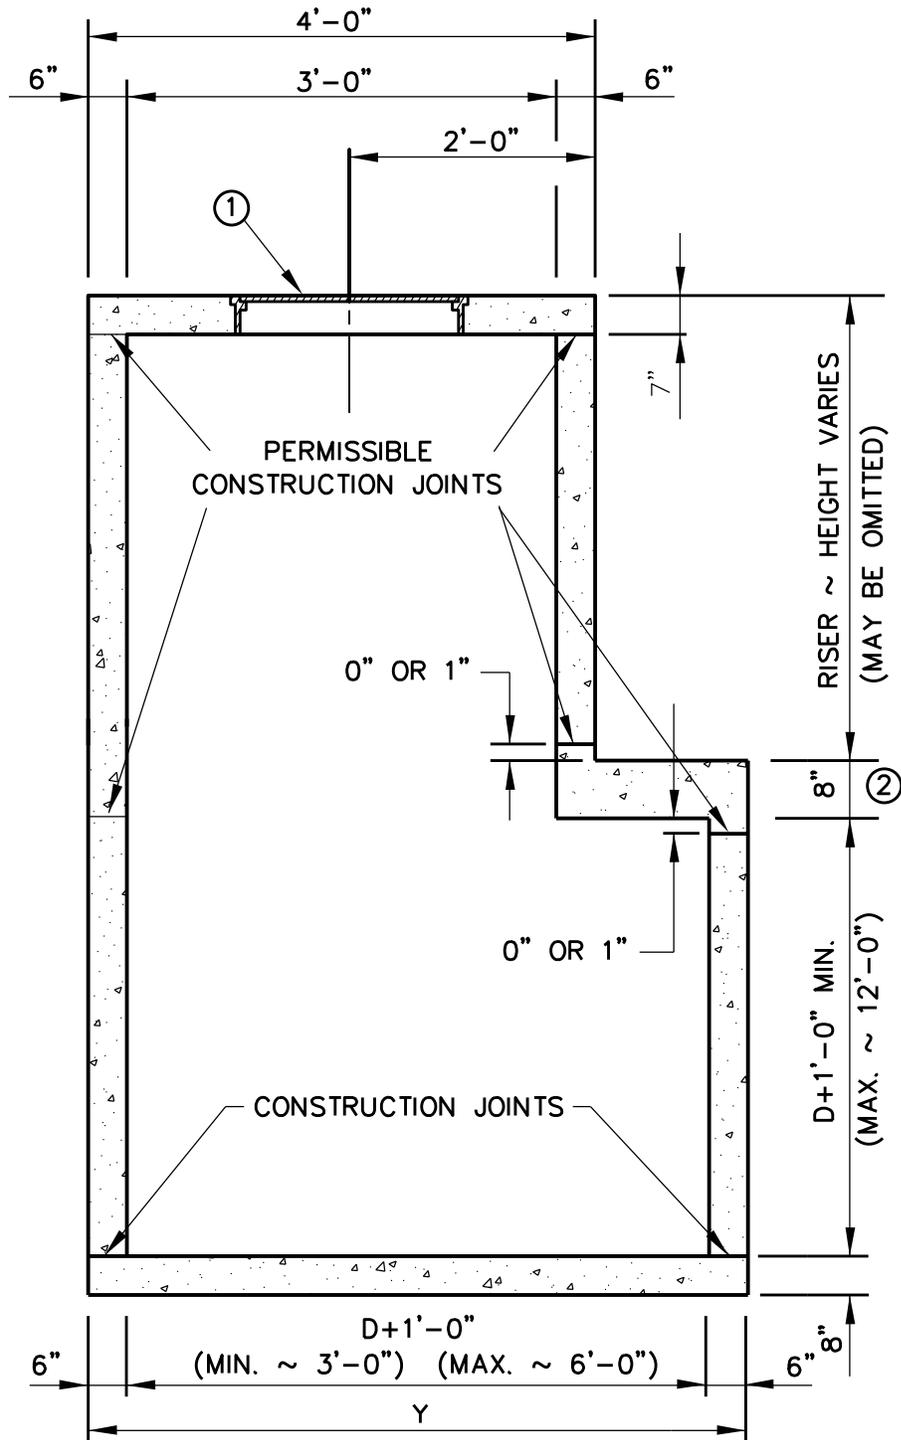

SECTION A-A

- ① SEE RING & COVER DETAILS ON SHEET 6 OF 6
- ② FOR 0'-15' OF FILL


2
6

Revision Date:

Scale : N/A	Date : 06/01/05
Design :	
Drawn : GAV	
Dwg. File : SMH_001.DWG	
Project No. : STANDARD-DETAILS	



**STORM SEWER MANHOLE
WITH CAST-IN-PLACE RISER**

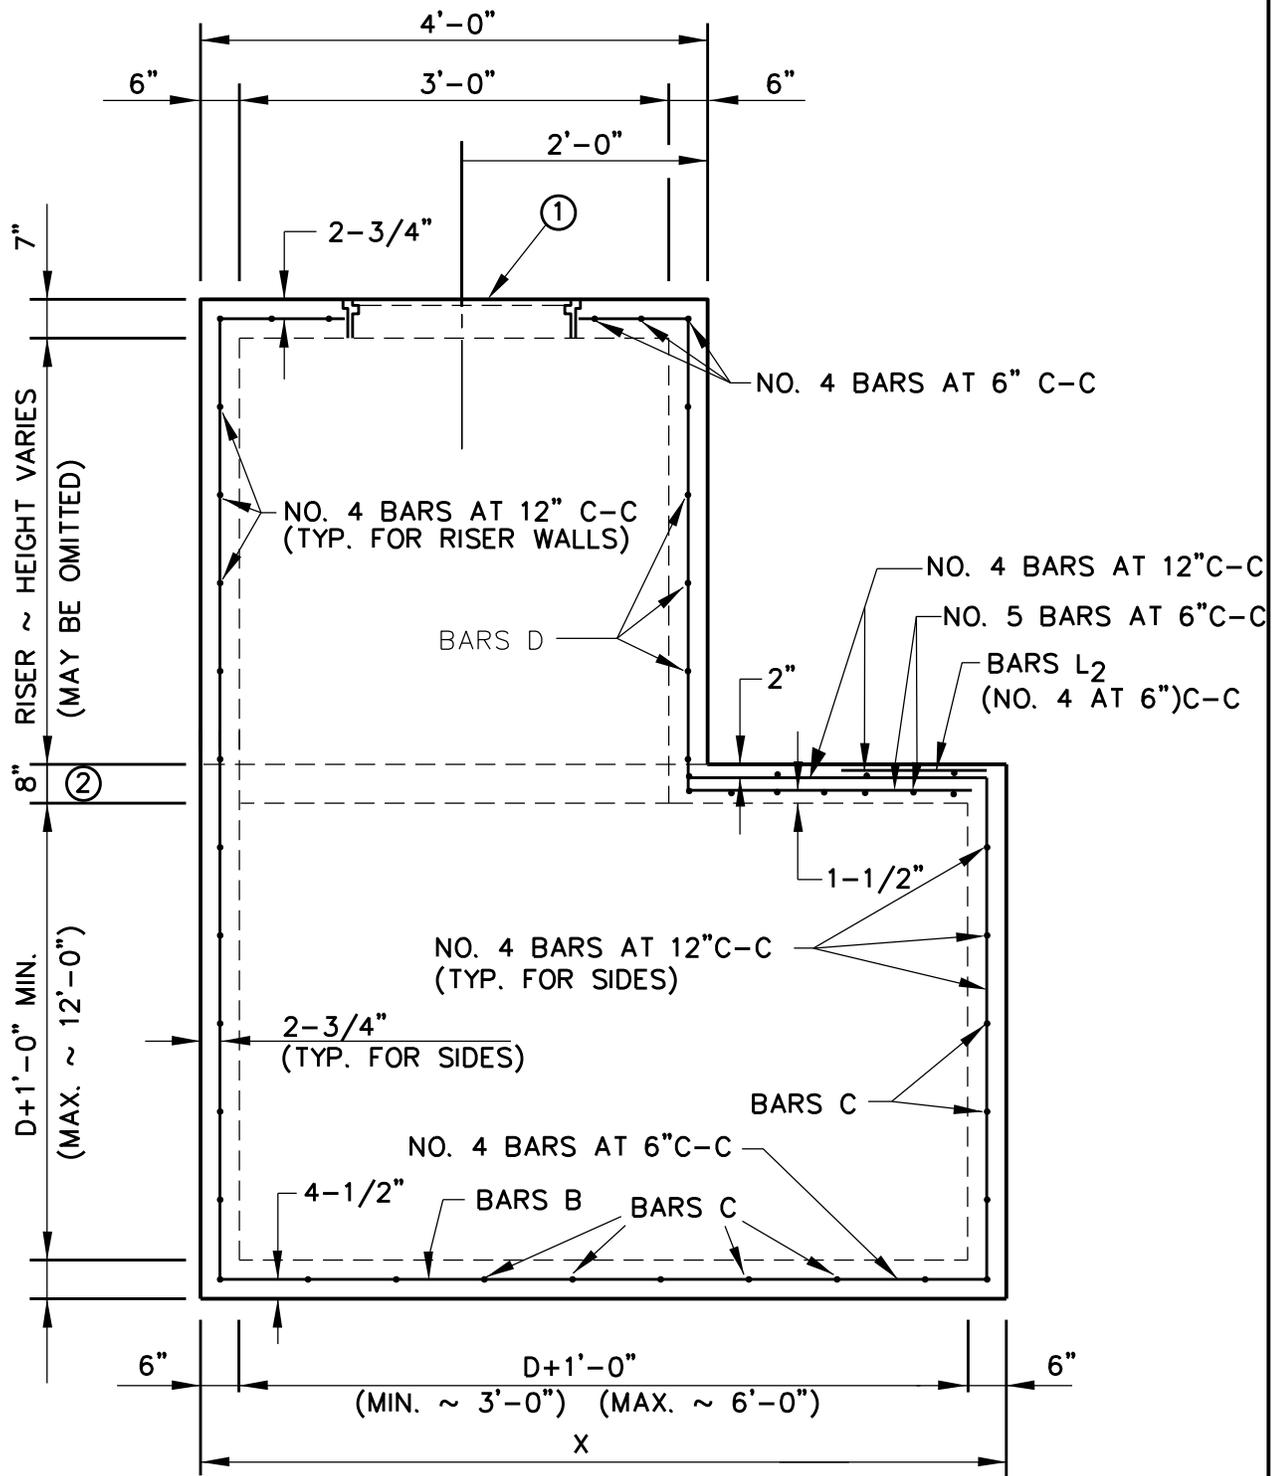

SECTION B-B

① SEE RING & COVER DETAILS ON SHEET 5 OF 6

② FOR 0'-15' OF FILL

D = MAXIMUM INSIDE DIAMETER OF ANY PIPE ENTERING THE SIDE SHOWN OR THE OPPOSITE SIDE

3
6

Revision Date: _____


Scale : N/A	Date :06/01/05
Design :	
Drawn : GAV	
Dwg. File : SMH_001.DWG	
Project No. : STANDARD-DETAILS	



STORM SEWER MANHOLE WITH CAST-IN-PLACE RISER

PAGE


3

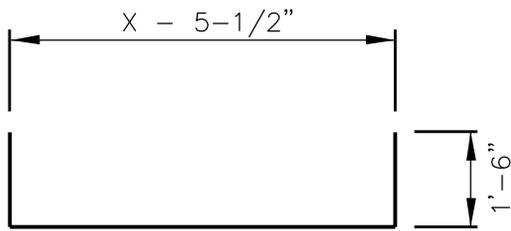


BARS B




BARS L1

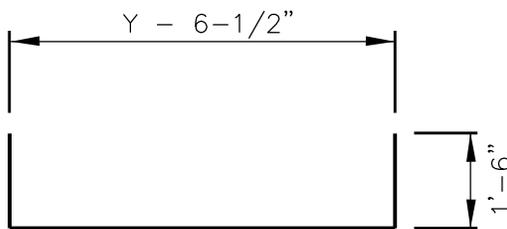


BARS C



BARS L2

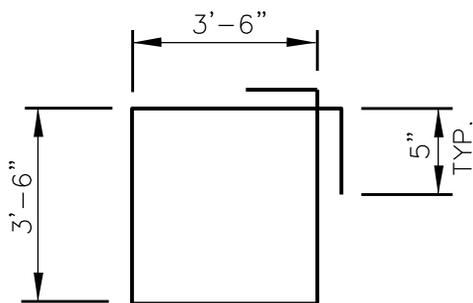

BARS D

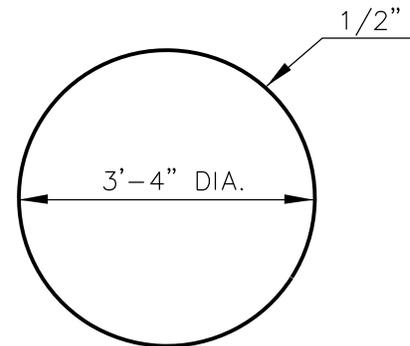

CONCENTRIC BARS

Revision Date:

Scale : N/A Date :06/01/05

Design :

Drawn : GAV

Dwg. File : SMH_001.DWG



Project No. : STANDARD-DETAILS




STORM SEWER MANHOLE
WITH CAST-IN-PLACE RISER
(STEEL DETAILS)

PAGE


4

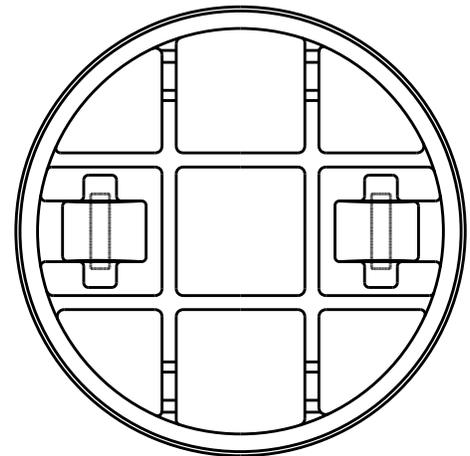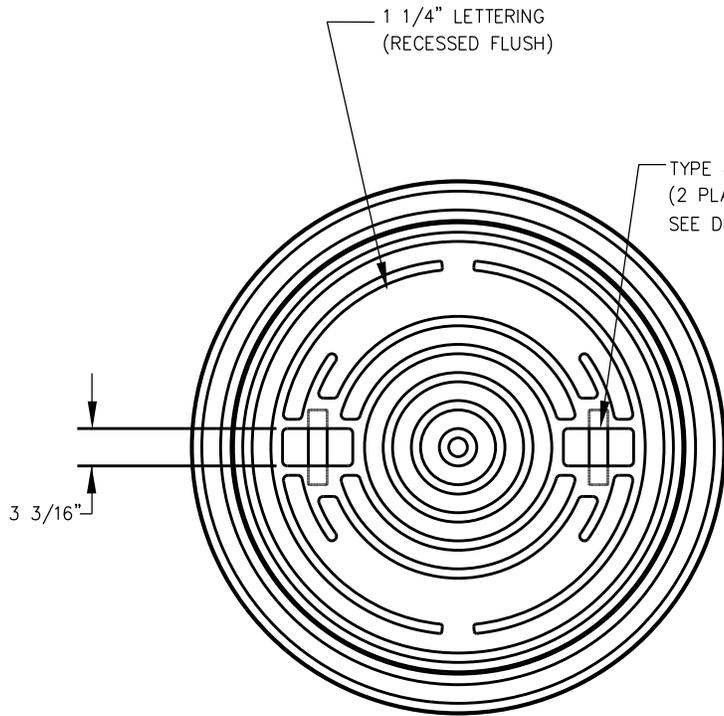


BOTTOM VIEW

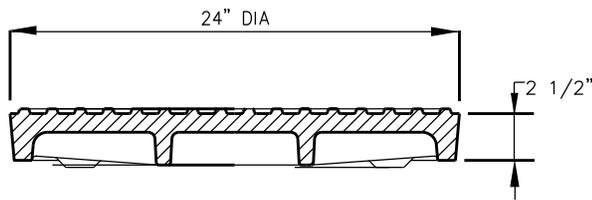

SECTION

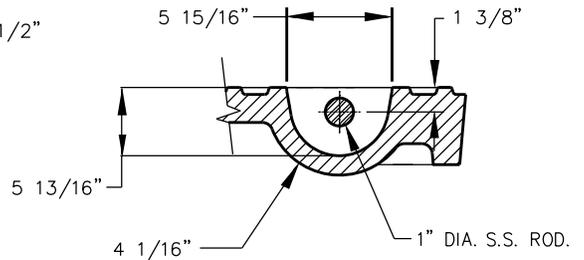

PICKBAR DETAIL

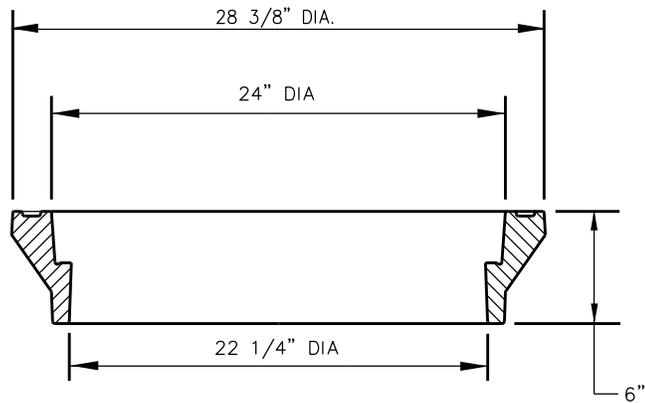

SECTION

BH 380-24R
 COVER: 183 LBS
 RING: 190 LBS
 UNIT: 373 LBS

5
 6

Revision Date:

Scale : N/A Date :06/01/05
 Design :
 Drawn : GAV
 Dwg. File : SMH_001.DWG
 Project No. : STANDARD-DETAILS



GARLAND
 ENGINEERING
 STANDARD DETAILS

**STORM SEWER DETAIL
 MANHOLE COVER**

PAGE
5

GENERAL NOTES

1. EXPOSED EDGES SHALL BE CHAMFERED 3/4".
2. ALTERNATE DESIGN DRAWINGS BEARING THE SEAL OF A REGISTERED PROFESSIONAL ENGINEER WILL BE ACCEPTABLE FOR PRECAST CONSTRUCTION OF MANHOLES.
3. SHOP DRAWINGS WILL NOT BE REQUIRED.
4. THE CONTRACTOR MAY WITH THE APPROVAL OF THE ENGINEER FURNISH MANHOLES OF EQUIVALENT STRUCTURAL DESIGN.
5. IN AREAS OF CONFLICT BETWEEN REINFORCING STEEL, BLOCKOUTS, PIPES, ANCHOR BOLTS OR OTHER REINFORCING STEEL, THE REINFORCEMENT SHALL BE BENT OR ADJUSTED TO CLEAR AS DIRECTED BY THE ENGINEER.
6. THE RISER MAY BE CONSTRUCTED OF REINFORCED CLASS "A" (3000 PSI) CONCRETE AS SHOWN USING REINFORCED CONCRETE PIPE, CLASS III, IN ACCORDANCE WITH ASTM DESIGNATION C-76. IF PIPE IS USED, JOINTS SHALL CONFORM TO THE ITEM "REINFORCED CONCRETE PIPE CULVERTS".
7. CONNECTING PIPES SHOULD BE WITHIN 10 DEGREES OF NORMAL TO THE INLET IF POSSIBLE. PIPE ELBOW OR CURBED APPROACH ALIGNMENT SHOULD BE USED TO STAY WITHIN THIS LIMIT.

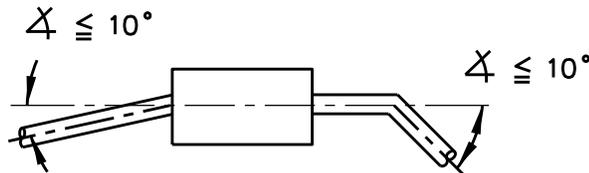

8. PIPES MAY CONNECT ON ANY WALL. THE MAXIMUM LENGTH OF PIPE THAT CAN BE ACCOMODATED IS 60". MORE THAN ONE PIPE MAY ENTER A SIDE SUBJECT TO THE MAXIMUM BOX DIMENSIONS SHOWN. THE CLEAR DISTANCE BETWEEN ADJACENT PIPES SHOULD BE 9" MINIMUM.
9. MANHOLE RING & COVER SHALL BE BASS AND HAYS 380-24R OR APPROVED EQUAL.
10. ALL STORM SEWER STRUCTURES SHALL BE CLASS 'C' CAST-IN-PLACE CONCRETE (UNLESS AUTHORIZED BY CITY OF GARLAND).

6
6

Revision Date: 07/07

Scale : N/A Date :06/01/05

Design :

Drawn : GAV

Dwg. File : SMH_001.DWG

Project No. : STANDARD-DETAILS


GARLAND
ENGINEERING
STANDARD DETAILS

**STORM SEWER MANHOLE
GENERAL NOTES**

PAGE

6